


**PEE DEE ELECTRIC COOPERATIVE, INC**  
**TEMPORARY METER POLE**

**PLEASE READ CAREFULLY**

**NOTES:**

1. ALL METER POLE LOCATIONS MUST BE APPROVED BY PEE DEE ELECTRIC COOP INC.
2. DO NOT INSTALL METERING EQUIPMENT ON PEE DEE ELECTRIC POLES.
3. ENTRANCE CABLE TO WEATHERHEAD AT 13'-6" MIN. ABOVE GRADE WITH ENDS OF CABLE AT LEAST 12" LONG.
4. METER POLE- STURDY ENOUGH TO HOLD SERVICE CABLE, USING ANY BRACING OR GUYING NECESSARY.
5. ANTENNAS, LIGHTS, BASKETBALL GOALS, CLOTHES LINES, ETC. ARE NOT TO BE INSTALLED ON THIS POLE.
6. THE NATIONAL ELECTRICAL CODE REQUIRES GROUND FAULT INTERRUPTERS TO BE INSTALLED.

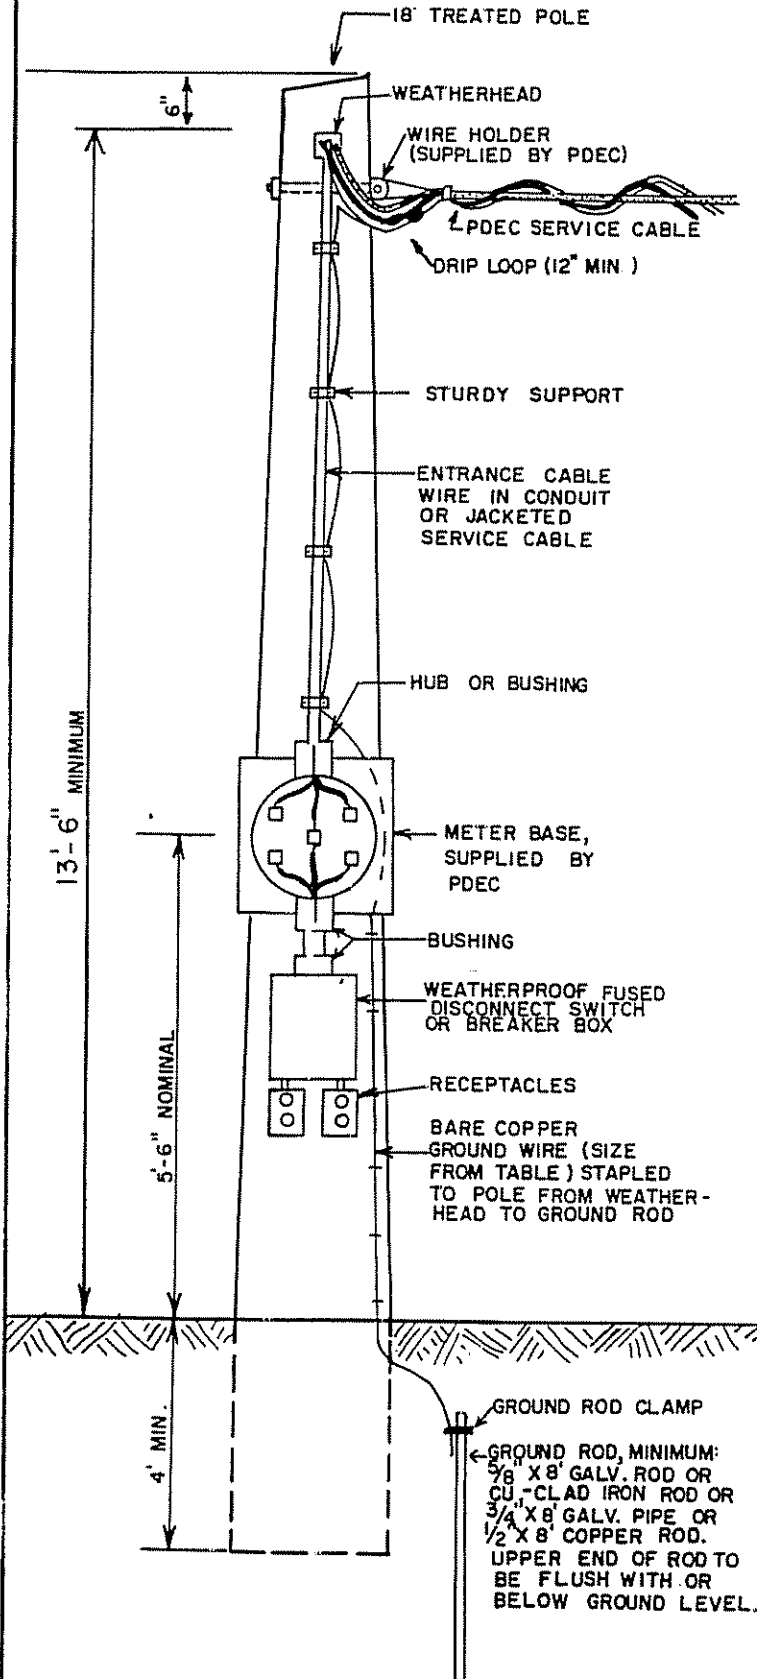

MAIN ENTRANCE SIZE IN AMPS	SIZE COPPER SERVICE WIRE	SIZE RIGID CONDUIT	SIZE ALUMINUM SERVICE WIRE	SIZE RIGID CONDUIT	SIZE GROUND WIRE (COPPER)
50	6	2"	4	2"	6
100	4	2"	2	2"	6
150	1	2"	2/0	2"	6

GROUND ROD CLAMP  
 GROUND ROD, MINIMUM:  
 5/8" X 8' GALV. ROD OR  
 CU-CLAD IRON ROD OR  
 3/4" X 8' GALV. PIPE OR  
 1/2" X 8' COPPER ROD.  
 UPPER END OF ROD TO  
 BE FLUSH WITH OR  
 BELOW GROUND LEVEL.