


PEE DEE ELECTRIC COOPERATIVE, INC.
TEMPORARY METER UNDERGROUND SERVICE POLE

PLEASE READ CAREFULLY

NOTES:

1. ALL METER POLE LOCATIONS MUST BE APPROVED BY PEE DEE ELECTRIC COOP., INC.
2. DO NOT INSTALL METERING EQUIPMENT ON PEE DEE ELECTRIC POLES.
3. METER POLES ARE TO BE USED ONLY FOR METERING PURPOSES.
4. NATIONAL ELECTRIC CODE REQUIRES GROUND FAULT INTERRUPTERS TO BE INSTALLED.
5. CONDUIT CAN BE EMT OR PVC. USE INSULATED BUSHING AT ENDS BELOW GRADE. NO WHITE PLASTIC WATER PIPE.

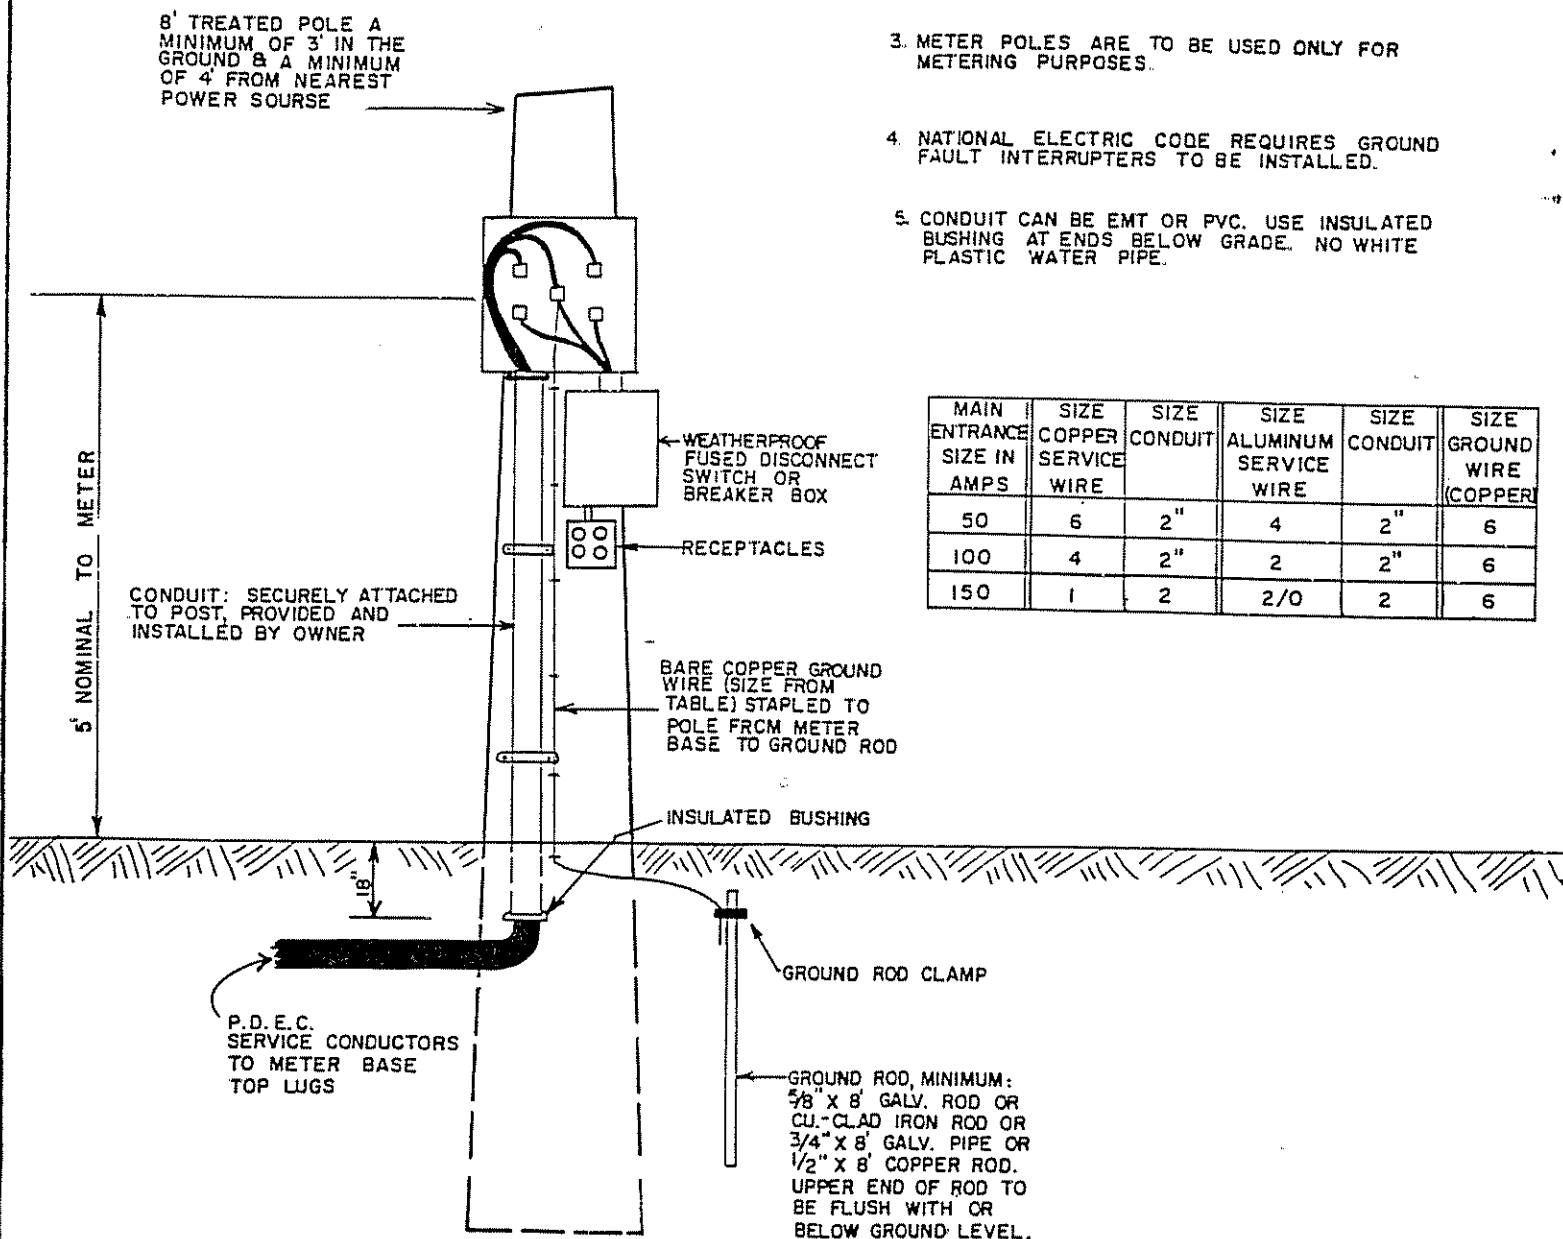

MAIN ENTRANCE SIZE IN AMPS	SIZE COPPER SERVICE WIRE	SIZE CONDUIT	SIZE ALUMINUM SERVICE WIRE	SIZE CONDUIT	SIZE GROUND WIRE (COPPER)
50	6	2"	4	2"	6
100	4	2"	2	2"	6
150	1	2	2/0	2	6